

City of Irving Inspections Department Requirements - Mobile Food Units / Ice Cream Pushcarts

HEALTH INSPECTION – REQUIREMENTS

*Indicates that the information required is for mobile food units only

- **Mobile food units must be in full working order for inspection***
- Completed and legible City of Irving health permit application
- Fee: mobile food units - \$200 / ice cream pushcarts - \$100
- Photocopy of the driver's / operator's valid driver's license*
- Photocopy of vehicle current vehicle liability insurance*
- Photocopy of Certified Food Protection Manager's certificate*
- Signed and notarized central preparation facility form (commissary note - current within last 12 months)*
- Photocopy of the commissary's last health inspection report*
- Menu of all food items to be sold*
- Business name in 4 inch high lettering in a contrasting color on 2 opposite exterior sides of the vehicle
- Must provide an on board power source, such as a battery or generator, to assure maintenance of time/temperature control for safety foods at proper temperatures during transit, preparation and service*
- A retention tank with cap*
- A three compartment sink with hot and cold running water (minimum: 110°F)*
- A hand wash sink with soap, paper towels, hot and cold running water (minimum: 100°F)*
- Refrigeration and hot holds must function / maintain internal temperature of foods $\leq 41^{\circ}\text{F}$ or $\geq 135^{\circ}\text{F}$ *
- A probe thermometer (a digital probe thermometer may be required based on menu items)*
- Internal thermometers for each refrigeration & hot hold unit*
- Sanitizer, sanitizer test papers, and disposable gloves*
- All food/non-food contact surfaces and equipment must be NSF certified & in good repair*
- Mobile units must be completely enclosed and outer openings sealed to prevent pest entry and dust*
- All food preparation and dispensing must take place inside of the mobile food unit*
- An itinerary and / or route may be required if deemed necessary by the Inspections Department*
- Additional requirements may be deemed necessary by the Inspections Department

ADDITIONAL FOOD CODE REQUIREMENTS

- Food invoices / receipts must be maintained on mobile food units for foods stored in the mobile unit*
- All food shall come from an approved source. Preparation / storage of food at a residence is prohibited
- Pre-packaged food shall be labeled according to Texas food manufacturer's regulations
- Mobile food units (hot / cold trucks) must only serve prepackaged foods with labels (If a mobile operator purchases food containing meat, the provider of the meals must be licensed to sell meat products, which require state or federal marks of inspection)*
- Toilet rooms shall be conveniently located and accessible to employees during all hours of operation*
- All foods must be stored inside the pushcart. Any foods found outside of the cart are subject to citation
- Pushcart - Any time/temperature control for safety foods or unwrapped foods are subject to citation and/or seizure (and destruction) by the City of Irving

FIRE INSPECTION – REQUIREMENTS




- Provide gas leak test
- Provide minimum 2A10BC rated fire extinguisher mounted on an appropriate bracket*
- Provide K rated fire extinguisher if using a solid fuel cooking appliance with fireboxes 5 cubic feet or less or a deep-fat fryer*
- Refer to food truck safety fact sheet for more information. Contact 972-721-2651 for any questions

Inspection times and location: Monday through Thursday from 8:00 - 9:00
City of Irving; 825 W. Irving Blvd., Irving TX 75060; 972-721-2371

The applicant is not entitled to a refund of permit fees if a permit is not approved by the department. After 1 customary follow-up inspection, a \$60 follow-up inspection fee may be assessed for each visit until the mobile food unit permit has been approved



FOOD TRUCK SAFETY

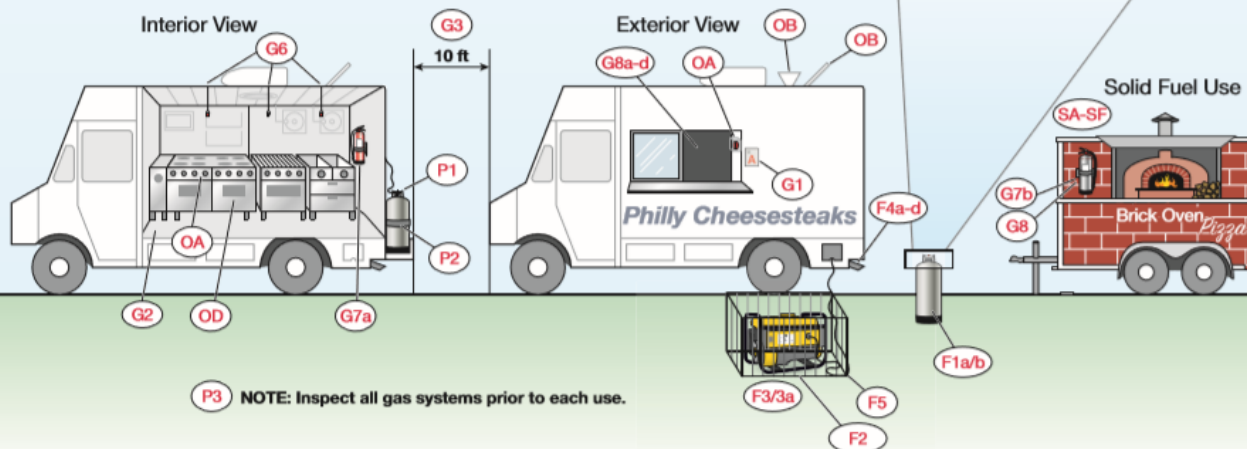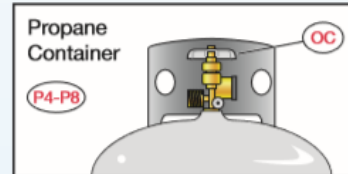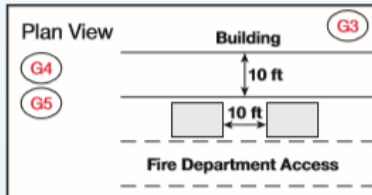

NFPA code references are provided at the end of each item. The red keys correspond to the NFPA food truck safety diagram. For more detailed information, see NFPA 1 and Annex B in NFPA 96.

General Safety Checklist

- Obtain license or permits from the local authorities. [1:1.12.8(a)] **G1**
- Ensure there is no public seating within the mobile food truck. [1:50.7.1.6.3] **G2**
- Check that there is a clearance of at least 10 ft away from buildings, structures, vehicles, and any combustible materials. [96:7.8.2; 96:7.8.3 for carnivals only] **G3**
- Verify fire department vehicular access is provided for fire lanes and access roads. [1:18.2.4] **G4**
- Ensure clearance is provided for the fire department to access fire hydrants and access fire department connections. [1:13.1.3; 1:13.1.4; 1:13.1.5] **G5**
- Check that appliances using combustible media are protected by an approved fire extinguishing system. [96:10.1.2] **G6**
- Verify portable fire extinguishers have been selected and installed in kitchen cooking areas in accordance with NFPA 10. [96:10.9.3] **G7a**
- Where solid fuel cooking appliance produce grease-laden vapors, make sure the appliances are protected by listed fire-extinguishing equipment. [96:14.7.1] **G7b**
- Ensure that workers are trained in the following: [96:B.15.1]: **G8**
 - Proper use of portable fire extinguishers and extinguishing systems [10:1.2] **G8a**
 - Proper method of shutting off fuel sources [96:10.4.1] **G8b**
 - Proper procedure for notifying the local fire department [1:10.14.9 for carnivals only] **G8c**
 - Proper procedure for how to perform simple leak test on gas connections [58:6.16, 58:6.17] **G8d**

FOOD TRUCK SAFETY CONTINUED

Fuel & Power Sources Checklist

- ❑ Verify that fuel tanks are filled to the capacity needed for uninterrupted operation during normal operating hours. [1:10.14.10.1 for carnivals only] **F1a**
- ❑ Ensure that refueling is conducted only during non-operating hours. [96:B.18.3] **F1b**
- ❑ Check that any engine-driven source of power is separated from the public by barriers, such as physical guards, fencing, or enclosures. [96:B.16.2.2] **F2**
- ❑ Ensure that any engine-driven source of power is shut down prior to refueling from a portable container. [1:11.7.2.1.2] **F3**
- ❑ Check that surfaces of engine-driven source of power are cool to the touch prior to refueling from a portable container. **F3a**
- ❑ Make sure that exhaust from engine-driven source of power complies with the following: **F4**
 - ❑ At least 10 ft in all directions from openings and air intakes [96:B.13] **F4a**
 - ❑ At least 10 ft from every means of egress [96:B.13] **F4b**
 - ❑ Directed away from all buildings [1:11.7.2.2] **F4c**
 - ❑ Directed away from all other cooking vehicles and operations [1:11.7.2.2] **F4d**
- ❑ Ensure that all electrical appliances, fixtures, equipment, and wiring complies with the NFPA 70®. [96:B.18] **F5**

Propane System Integrity Checklist

- ❑ Check that the main shutoff valve on all gas containers is readily accessible. [58:6.26.4.1(3)] **P1**
- ❑ Ensure that portable gas containers are in the upright position and secured to prevent tipping over. [58:6.26.3.4] **P2**
- ❑ Inspect gas systems prior to each use. [96:B.19.2.3] **P3**
- ❑ Perform leak testing on all new gas connections of the gas system. [58:6.16; 58:6.17] **P4**
- ❑ Perform leak testing on all gas connections affected by replacement of an exchangeable container. [58:6.16; 58:6.17] **P5**
- ❑ Document leak testing and make documentation available for review by the authorized official. [58:6.26.5.1(M)] **P6**
- ❑ Ensure that on gas system piping, a flexible connector is installed between the regulator outlet and the fixed piping system. [58:6.26.5.1(B)] **P7**
- ❑ Where a gas detection system is installed, ensure that it has been tested in accordance with the manufacturer's instructions. [96:B.19.2.1] **P8**

Operational Safety Checklist

- ❑ Do not leave cooking equipment unattended while it is still hot. (This is the leading cause of home structure fires and home fire injuries.) **OA**
- ❑ Operate cooking equipment only when all windows, service hatches, and ventilation sources are fully opened. [96:14.2.2; 96:14.2.3] **OB**
- ❑ Close gas supply piping valves and gas container valves when equipment is not in use. [58:6.26.8.3] **OC**
- ❑ Keep cooking equipment, including the cooking ventilation system, clean by regularly removing grease. [96:11.4] **OD**

Solid Fuel Safety Checklist (Where Wood, Charcoal, Or Other Solid Fuel Is Used)

- ❑ Fuel is not stored above any heat-producing appliance or vent. [96:14.9.2.2] **SA**
- ❑ Fuel is not stored closer than 3 ft to any cooking appliance. [96:14.9.2.2] **SB**
- ❑ Fuel is not stored near any combustible flammable liquids, ignition sources, chemicals, and food supplies and packaged goods. [96:14.9.2.7] **SC**
- ❑ Fuel is not stored in the path of the ash removal or near removed ashes. [96:14.9.2.4] **SD**
- ❑ Ash, cinders, and other fire debris should be removed from the firebox at regular intervals and at least once a day. [96:14.9.3.6.1] **SE**
- ❑ Removed ashes, cinders, and other removed fire debris should be placed in a closed, metal container located at least 3 ft from any cooking appliance. [96:14.9.3.8] **SF**

NFPA RESOURCES

NFPA 1, *Fire Code*, 2018 Edition
NFPA 1 *Fire Code Handbook*, 2018 Edition
NFPA 58, *Liquefied Petroleum Gas Code*, 2017 Edition
LP-Gas Code Handbook, 2017 Edition
NFPA 70®, *National Electrical Code*®, 2017 Edition
National Electrical Code® *Handbook*, 2017 Edition
NFPA 96, *Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations*, 2017 Edition
NFPA 96: *Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations Handbook*, 2017 Edition

➔ **BECOME AN NFPA MEMBER**
FOR MORE OF THESE RESOURCES



IT'S A BIG WORLD.
LET'S PROTECT IT TOGETHER.™

NOTE: This information is provided to help advance safety of mobile and temporary cooking operations. It is not intended to be a comprehensive list of requirements for mobile and temporary cooking operations. Check with the local jurisdiction for specific requirements. This safety sheet does not represent the official position of the NFPA or its Technical Committees. The NFPA disclaims liability for any personal injury, property, or other damages of any nature whatsoever resulting from the use of this information. For more information, go to nfpa.org/foodtrucksafety.

© 2018 National Fire Protection Association / August 2018